


Model Number	Nominal Size (inches) W x H x D	Actual Size (inches) W x H x D	Rated Air Flow (CFM)	Initial Resistance (IN W.G.)	Media Area (Square Feet)
XPH-STD4-410	12 x 24 x 4	11- ³ / ₈ x 23- ³ / ₈ x 3- ³ / ₄	1000	.23	13.0
XPH-STD4-401	16 x 20 x 4	15- ¹ / ₂ x 19- ¹ / ₂ x 3- ³ / ₄	1120	.23	14.9
XPH-STD4-402	16 x 25 x 4	15- ¹ / ₂ x 24- ¹ / ₂ x 3- ³ / ₄	1400	.23	18.8
XPH-STD4-412	18 x 24 x 4	17- ³ / ₈ x 23- ³ / ₈ x 3- ³ / ₄	1500	.23	19.7
XPH-STD4-403	20 x 20 x 4	19- ¹ / ₂ x 19- ¹ / ₂ x 3- ³ / ₄	1400	.23	22.2
XPH-STD4-411	20 x 24 x 4	19- ³ / ₈ x 23- ³ / ₈ x 3- ³ / ₄	1670	.23	18.5
XPH-STD4-404	20 x 25 x 4	19- ¹ / ₂ x 24- ¹ / ₂ x 3- ³ / ₄	1750	.23	22.3
XPH-STD4-405	24 x 24 x 4	23- ³ / ₈ x 23- ³ / ₈ x 3- ³ / ₄	2000	.23	26.5

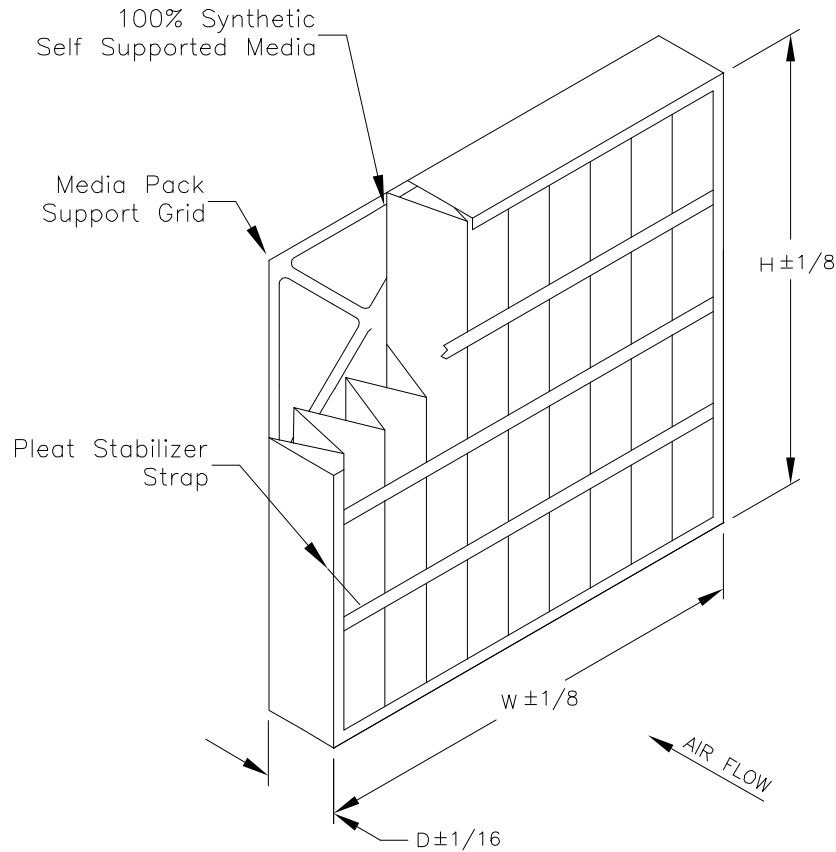

STANDARD CONSTRUCTION

- 100% Synthetic, Self Supported Media
- 11.3 Pleats Per Foot
- (3) Pleat Stabilizer Straps, Upstream Side
- Media Pack Support Grid, Downstream Side
- Moisture Resistant Beverage Board Frame

NOTES

- MERV 7 per ASHRAE 52.2-2007
- MERV-A 7-A per ASHRAE 52.2-2007, Appendix J
- Tested At 492 FPM on 24x24x4 Nominal Size
- Final Resistance: 1.0" W.G.
- Rated Velocity: 500 FPM
- Class 2 Filter Per U.L. Standard 900
- Maximum Operating Temperature: 150 deg. F



100 River Ridge Circle
Jeffersonville, IN 47130
P: 866-247-4827
F: 502-961-0930
www.airguard.com

CONTACT FACTORY TO
VERIFY REVISION LEVEL

TOLERANCES UNLESS OTHERWISE SPECIFIED

FRACTIONAL -
DECIMAL -
ANGLES -

ALL DIMENSIONS IN INCHES

DRAWING NAME

XTREME+PLUS HIGH CAPACITY SSP 4" DEPTH

APPROVED BY

[Signature]

SPECIFICATION NO.

MKT-B-00610

PAGE

1 OF 1

SCALE

NONE

DWG. SIZE

A

REVISION

NEW

REVISION DATE

08-27-10

CONFIDENTIAL - DO NOT COPY. THIS MATERIAL IS TRADE SECRET AND PROPRIETARY BEING EXCLUSIVELY OWNED BY CLC AIR. THE EXPRESSION OF THE INFORMATION CONTAINED HEREIN IS PROTECTED UNDER FEDERAL COPYRIGHT LAWS AND ALL COPYING IS PROHIBITED AND MAY BE SUBJECT TO CRIMINAL PENALTIES.